


CURVE SHOWS APPROXIMATE PERFORMANCE FOR CLEAR WATER (International Test Standard ISO9906:1999 - Grade 2 unless otherwise specified). For media other than water, corrections must be made for density, viscosity and/or other effects of solids. WEIR MINERALS reserves the right to change pump performance and/or delete impellers without notice. Frame suitability must be checked for each duty and drive arrangement. Not all frame alternatives are necessarily available from each manufacturing centre.

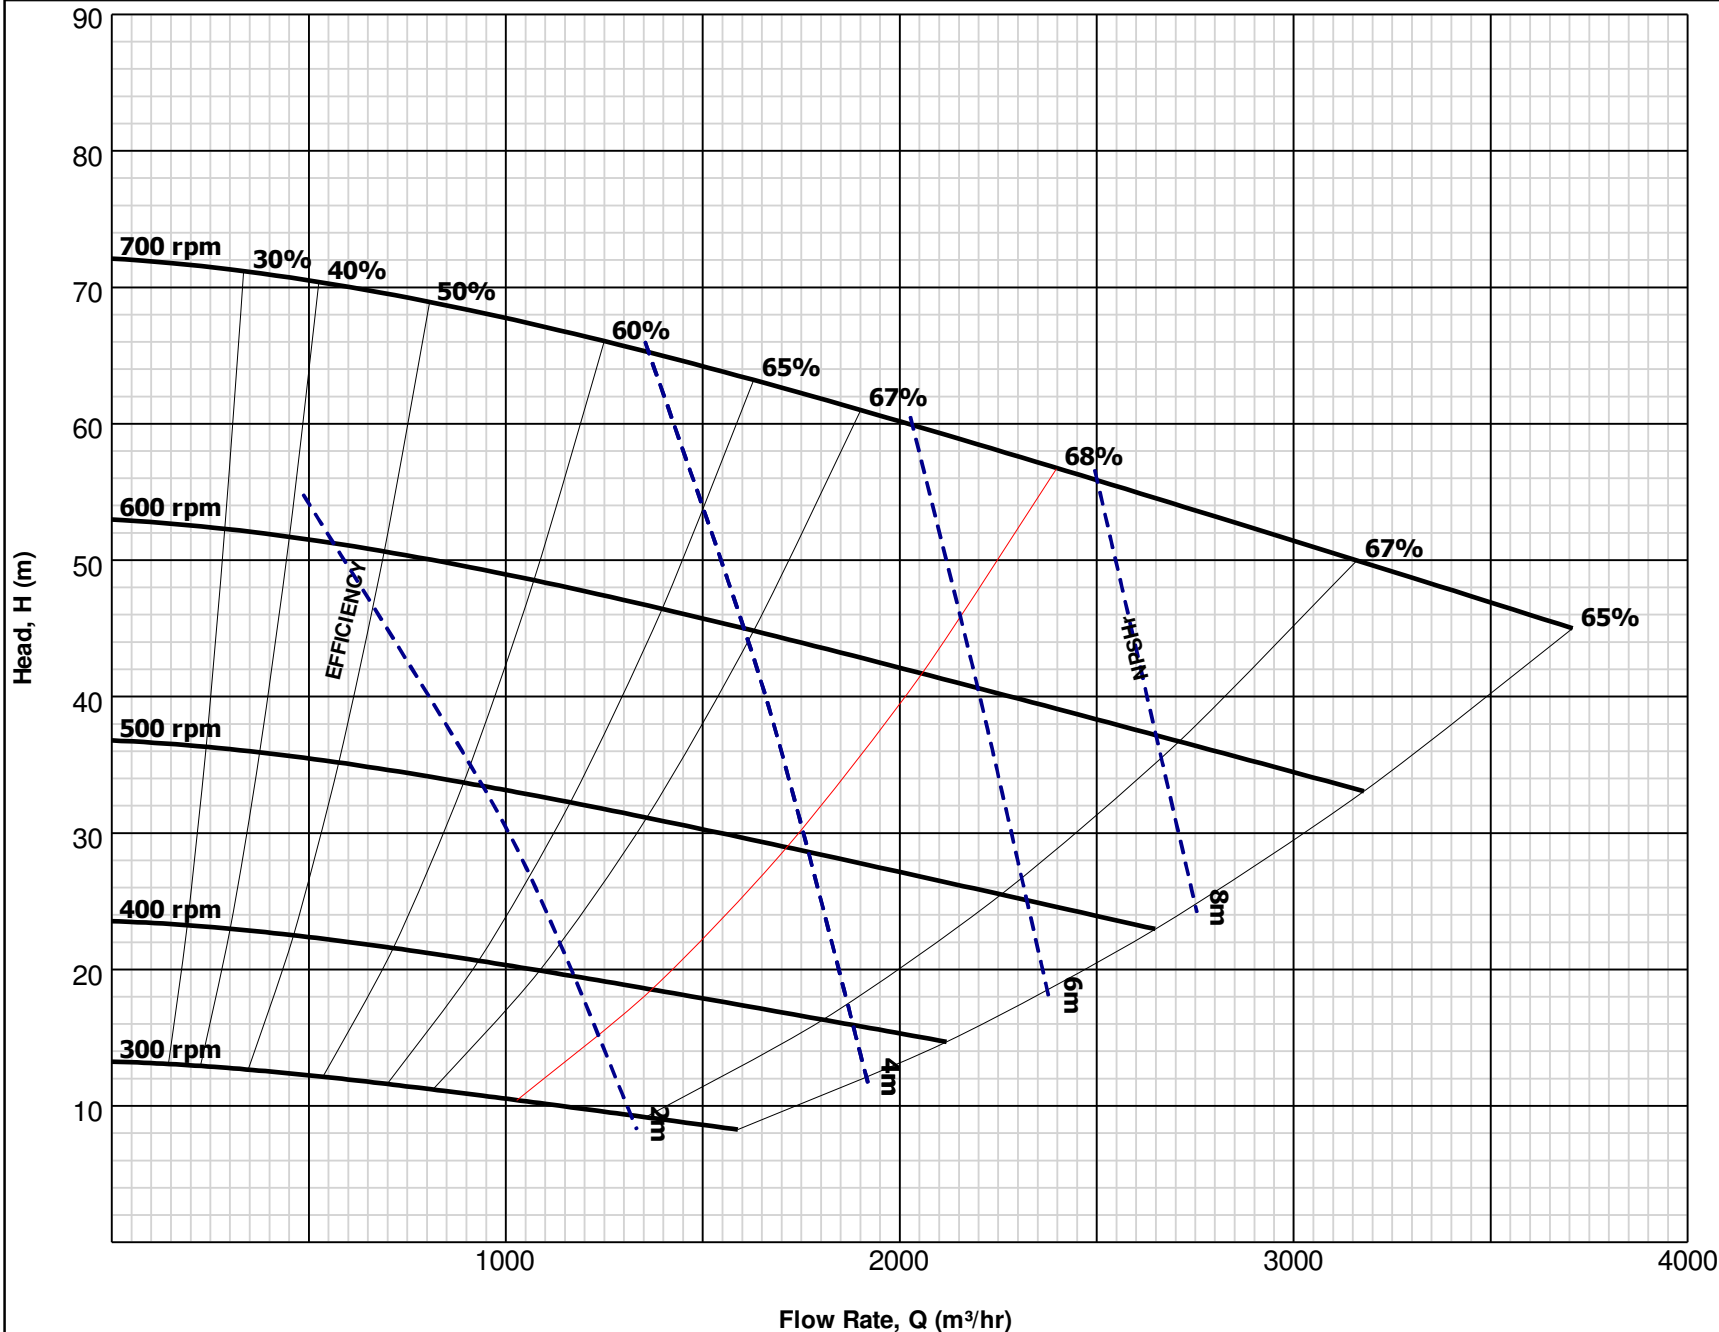

Pump	
Discharge	305mm
Suction	356mm
Impeller	
Vanes	3
Vane ø	864mm
Type	Closed
Part No	Material
GG12137	Metal
Frame (Rating - KW)	
G	600
GG	900
T	1200
Seal	
Gland Sealed Pump	
Liner (Norm Max r/min)	
Unlined	700
Min Passage Size	
241mm	
Curve	
Revision	2
Revision Notes	CURVE DATA REVISED
Reference	TEST 6: A800314:A4-P-315 & 316
Last Issued	Dec 96
Issued	Dec 05
© 7/2014 Weir Minerals Australia (PTC) All Rights Reserved	
TYPICAL PUMP PERFORMANCE CURVE	
WPA1412A11/2	