

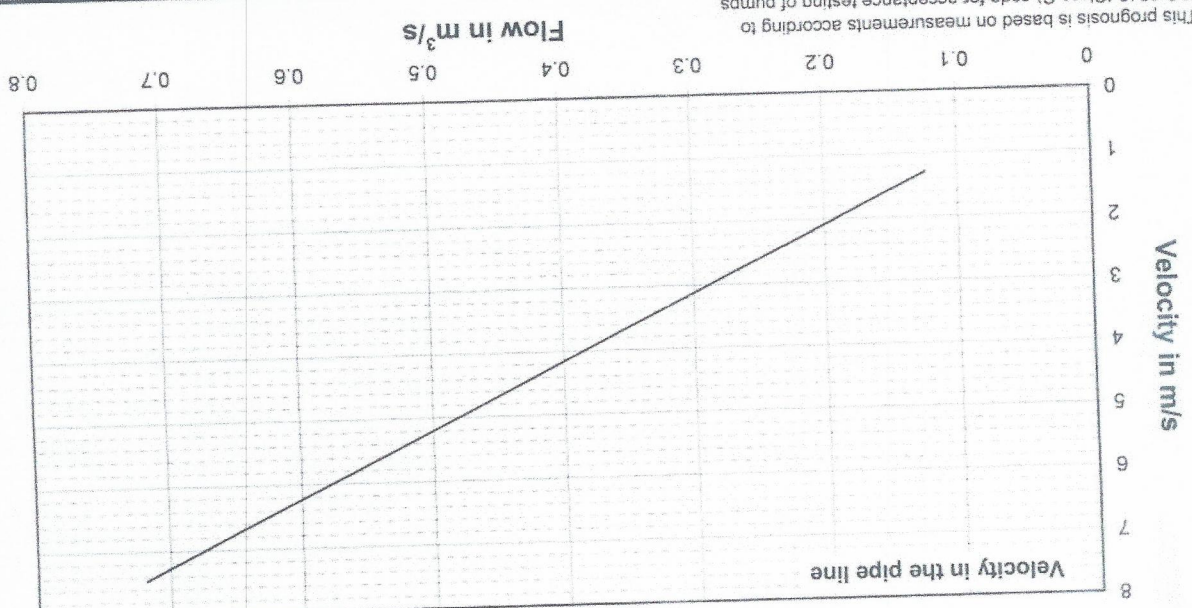


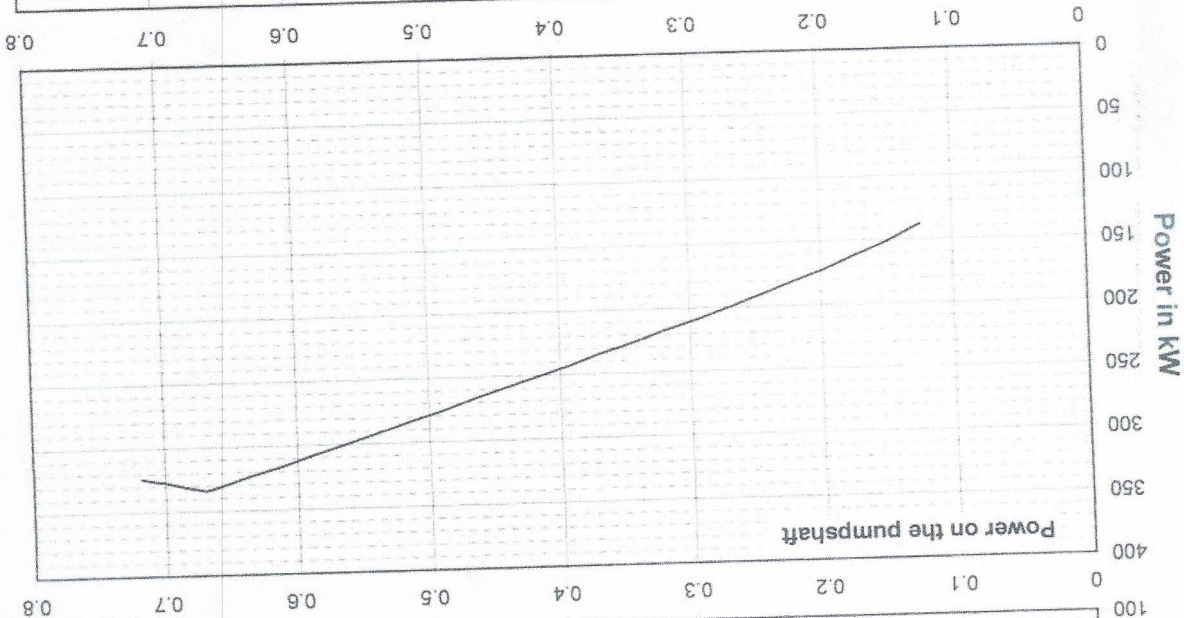

12. Cal 108-06

IHC Merwede

Pump characteristics calculated for water

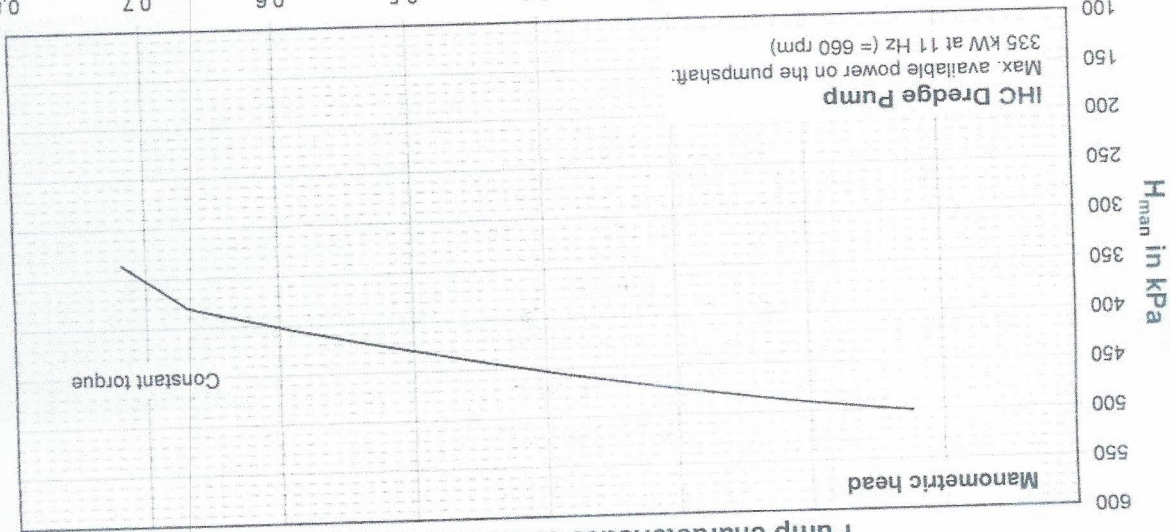

This prognosis is based on measurements according to ISO 2548 (Class C) code for acceptance testing of pumps

Pump type IHC 83-18-35, with a 3-bladed impeller

Report:

Page:

Beaver Master

© Copyright IHC

Date: 19-Feb-2009